



Certificate of Conformity self-generation unit

Manufacturer / applicant: ALTENERGY Power system Inc.
No.1 Yatai Road,
Jiaxing 314050 Zhejiang Province,
P.R. China

Type of power generation unit: Grid-tied photovoltaic inverter

Name of PGU:	YC600
Active power (nominal power at reference conditions) [W]:	550
Rated voltage:	230V; N; PE

Firmware version: V5

Connection rule: **VDE-AR-N 4105:2011-08 – Power generation systems connected to the low-voltage distribution network**

Technical minimum requirements for the connection to and parallel operation with low-voltage distribution networks.

Applicable standards / directives: **DIN VDE V 0124-100 (VDE V 0124-100): 2012-07 – Grid integration of power generation systems – low voltage**

Test requirements for power generation units to be connected and operated parallel with the low-voltage distribution networks

The above mentioned generation unit has been tested and certified according to the test guideline VDE 0124-100. The electrical properties required in the connection rule are satisfied.

- Verification of permissible system perturbations
- Verification of the symmetry characteristics of three-phase inverter modules
- Verification of the characteristics of the power generation unit on the network
- Verification of the possibility to take part in the generation management / network security management

The certificate contains the following information:

- Technical specifications of the power generation unit, the deployed auxiliary equipment and the software version used.
- Schematic structure of power generation unit
- Summarized information about the characteristics of the power generation unit (mode of operation)

BV project number: ZEK-18JA0679FCSP

Certificate number: U18-0290

Date of issue: 2018-05-25



(A partial representation of the certificate requires the written permission
of Bureau Veritas Consumer Products Services Germany GmbH)

Certification body of Bureau Veritas Consumer Products Services Germany GmbH
Accredited according to DIN EN ISO/IEC 17065



F.3 Requirements for the test report for power generation units

Extract from the test report for unit certification
 „Determination of electrical properties“


Nr. ZEK-18JA0679FCSP

Description of the power generation unit

Manufacturer / applicant:	ALTENERGY Power system Inc. No.1 Yatai Road, Jiaxing 314050 Zhejiang Province, P.R. China
Type of power generation unit:	Grid-tied photovoltaic inverter
Name of PGU:	YC600
Max. active power $P_{E\max}$ [W]:	550
Max. apparent power $S_{E\max}$ [VA]:	550
Rated voltage:	230V
Firmware version:	V5
Measurement period:	2018-01-27 to 2018-05-11

Description of the structure of the power generation unit:

The power generation unit is equipped with a PV and line-side EMC filter. The power generation unit has galvanic isolation between DC input and AC output (HF transformer). Output switch-off is performed with single-fault tolerance thanks to the inverter bridge and two series-connected relays. This enables a safe disconnection of the power generation unit from the network in case of error.

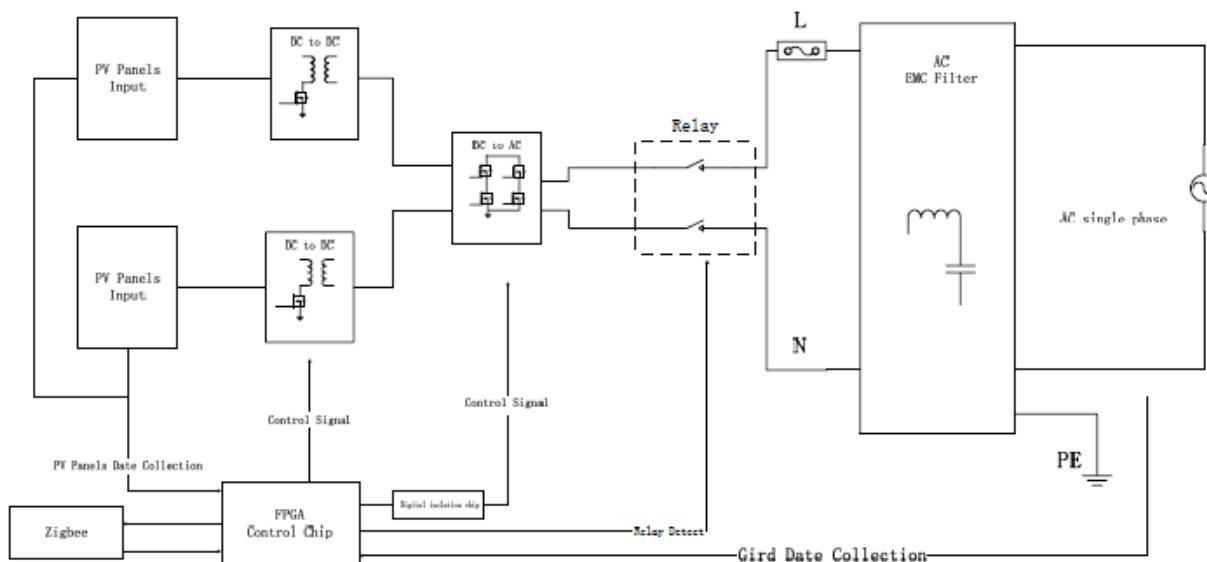



Annex to the Certificate of Conformity self-generation unit No. U18-0290

F.3 Requirements for the test report for power generation units

Extract from the test report for unit certification

Nr. ZEK-18JA0679FCSP

„Determination of electrical properties“

Active power

(tested according to VDE 0124-100 point 5.3.2.1)

Name of PGU:	YC600
P _{Emax} [kW] at cos φ = 1	0,549
S _{Emax} [kVA] at cos φ = 1	0,550
P _{Emax} [kW] at cos φ under-excite = 0,9	0,498
S _{Emax} [kVA] at cos φ under-excite = 0,9	0,552
P _{Emax} [kW] at cos φ over-excited = 0,9	0,497
S _{Emax} [kVA] at cos φ over-excited = 0,9	0,553

Note:

At cosφ = 1 the active power is equal to the rated apparent power.

For the implementation of a reactive power set point assignment, the active power is reduced if necessary.

Reactive power supply

(tested according to VDE 0124-100 point 5.3.6.1)

Active power	40 – 60 %P _{Emax}	S _{Emax}
Name of PGU:	YC600	
COS φ under-excite:	0,904	0,903
COS φ over-excited	0,902	0,902
COS φ setpoint	0,900	0,900

The self-generation unit is approved for self-generation systems larger than 13,8 kVA. The self-generation unit has the possibility for regulation of the displacement factor in the range from cos φ 0,90 over-excited to cos φ 0,90 under-excited.

Reactive power transfer function – standard cos φ (P)-characteristic curve

(tested according to VDE 0124-100 point 5.3.6.4)

Active power P _{Emax setpoint} [%]	10	20	30	40	50	60	70	80	90	100
Name of PGU:	YC600									
Active power P _{Emax} [%]	N/A	21,3	30,5	39,5	52,4	59,1	69,3	79,5	89,8	90,4*
COS φ setpoint of P _{Emax}	N/A	1,0000	1,0000	1,0000	0,9953	0,9818	0,9615	0,9411	0,9204	0,9193
COS φ measured	N/A	0,9902	0,9906	0,9922	0,9957	0,9824	0,9603	0,9386	0,9175	0,9171

According to VDE 0124-100, an accuracy of cos φ 0,01 is required for testing the Reactive power transfer function. The standard cos φ-(P)-characteristic curve is respected. To provide the set point of the reactive power, active power will be reduced at 100 % P / P_{n..}

*For the implementation of a reactive power set point assignment, the active power is reduced.



Annex to the Certificate of Conformity self-generation unit No. U18-0290

F.3 Requirements for the test report for power generation units

Extract from the test report for unit certification

Nr. ZEK-18JA0679FCSP

„Determination of electrical properties“

Switching operations

(tested according to VDE 0124-100 point 5.1.2)

Switch-on without specification (to the primary energy source)	k_i	0,38
Switch-on at auxiliary conditions (of the primary energy source)	k_i	0,34
Worst value of all switching operations	k_i	0,38

Flicker

(tested according to VDE 0124-100 point 5.1.3)

Line impedance angle ψ_k :	32°
System flicker coefficient c_{ψ} :	24,87



Annex to the Certificate of Conformity self-generation unit No. U18-0290

F.3 Requirements for the test report for power generation units

Extract from the test report for unit certification

Nr. ZEK-18JA0679FCSP

„Determination of electrical properties“

Harmonics

(tested according to VDE 0124-100 point 5.1.4)

P/P _n [%]	0	10	20	30	40	50	60	70	80	90	100
Order	I _h [%]										
1	7,65	11,69	20,74	30,78	40,60	49,94	60,11	70,13	80,62	89,58	98,16
2	0,09	0,13	0,18	0,22	0,28	0,30	0,35	0,37	0,42	0,48	0,52
3	6,64	6,40	4,86	3,23	1,74	0,38	1,28	3,72	3,00	2,40	1,85
4	0,11	0,11	0,13	0,14	0,15	0,16	0,16	0,22	0,27	0,30	0,33
5	3,00	2,48	1,95	1,73	1,40	1,13	0,84	0,93	0,67	0,56	0,57
6	0,09	0,09	0,10	0,11	0,10	0,10	0,09	0,15	0,17	0,20	0,21
7	0,41	0,34	0,22	0,18	0,24	0,34	0,48	0,31	0,37	0,41	0,43
8	0,06	0,07	0,07	0,08	0,09	0,08	0,08	0,13	0,16	0,19	0,20
9	0,70	0,83	0,90	0,65	0,38	0,12	0,33	0,89	0,82	0,65	0,58
10	0,05	0,04	0,05	0,06	0,07	0,07	0,08	0,09	0,12	0,15	0,16
11	1,14	1,17	1,19	1,00	0,78	0,50	0,38	1,27	1,14	1,06	1,00
12	0,03	0,03	0,03	0,04	0,05	0,06	0,08	0,06	0,08	0,10	0,11
13	1,11	1,12	1,18	1,21	0,95	0,72	0,46	1,19	1,18	1,15	1,19
14	0,03	0,03	0,04	0,03	0,03	0,05	0,07	0,04	0,06	0,08	0,09
15	0,75	0,76	0,75	0,89	0,76	0,56	0,31	1,04	1,05	1,11	1,17
16	0,04	0,05	0,05	0,04	0,03	0,03	0,06	0,06	0,08	0,08	0,09
17	0,35	0,35	0,36	0,65	0,55	0,49	0,36	0,73	0,78	0,76	0,81
18	0,05	0,05	0,06	0,06	0,05	0,03	0,05	0,06	0,07	0,08	0,08
19	0,26	0,33	0,36	0,28	0,33	0,34	0,36	0,33	0,40	0,42	0,49
20	0,05	0,05	0,05	0,07	0,07	0,04	0,05	0,05	0,07	0,07	0,08
21	0,54	0,56	0,51	0,11	0,20	0,29	0,33	0,19	0,19	0,19	0,25
22	0,04	0,04	0,05	0,06	0,08	0,05	0,04	0,04	0,06	0,06	0,07
23	0,70	0,65	0,67	0,13	0,12	0,15	0,20	0,17	0,12	0,09	0,17
24	0,04	0,04	0,04	0,04	0,06	0,05	0,04	0,04	0,04	0,05	0,06
25	0,69	0,70	0,69	0,30	0,25	0,25	0,22	0,14	0,10	0,16	0,33
26	0,06	0,05	0,06	0,03	0,05	0,04	0,03	0,05	0,04	0,05	0,07
27	0,51	0,54	0,52	0,30	0,26	0,27	0,27	0,10	0,23	0,33	0,42
28	0,07	0,08	0,08	0,03	0,03	0,03	0,03	0,06	0,05	0,06	0,08
29	0,22	0,25	0,27	0,21	0,20	0,29	0,33	0,32	0,41	0,51	0,60
30	0,07	0,09	0,09	0,05	0,04	0,03	0,03	0,05	0,04	0,06	0,07
31	0,19	0,14	0,11	0,08	0,17	0,30	0,36	0,45	0,54	0,63	0,69
32	0,07	0,08	0,08	0,05	0,06	0,04	0,03	0,04	0,04	0,05	0,06
33	0,43	0,41	0,35	0,15	0,24	0,31	0,42	0,61	0,62	0,68	0,70
34	0,06	0,05	0,06	0,05	0,05	0,03	0,04	0,04	0,05	0,05	0,06
35	0,57	0,58	0,56	0,31	0,29	0,39	0,47	0,65	0,67	0,64	0,63
36	0,04	0,03	0,03	0,04	0,05	0,05	0,04	0,05	0,06	0,05	0,06
37	0,59	0,62	0,61	0,33	0,30	0,45	0,50	0,59	0,58	0,59	0,56
38	0,04	0,04	0,05	0,04	0,06	0,07	0,06	0,08	0,08	0,07	0,09
39	0,48	0,50	0,51	0,26	0,24	0,34	0,44	0,53	0,49	0,46	0,43
40	0,06	0,07	0,07	0,06	0,09	0,10	0,07	0,11	0,10	0,09	0,11



Annex to the Certificate of Conformity self-generation unit No. U18-0290

F.3 Requirements for the test report for power generation units

Extract from the test report for unit certification

Nr. ZEK-18JA0679FCSP

„Determination of electrical properties“

Inter-harmonics

(tested according to VDE 0124-100 point 5.1.4)

P/Pn [%]	0	10	20	30	40	50	60	70	80	90	100
f [Hz]	I _h [%]										
75	0,22	0,33	0,43	0,34	0,58	0,68	0,72	0,55	0,80	1,07	0,95
125	0,08	0,10	0,14	0,17	0,21	0,25	0,28	0,29	0,28	0,35	0,36
175	0,12	0,12	0,11	0,12	0,12	0,13	0,14	0,21	0,24	0,28	0,29
225	0,06	0,07	0,08	0,11	0,10	0,12	0,13	0,15	0,20	0,22	0,23
275	0,08	0,09	0,08	0,10	0,09	0,09	0,10	0,14	0,15	0,19	0,19
325	0,06	0,08	0,08	0,10	0,09	0,10	0,09	0,14	0,16	0,18	0,19
375	0,06	0,06	0,06	0,08	0,06	0,07	0,09	0,11	0,13	0,17	0,17
425	0,08	0,09	0,09	0,09	0,09	0,09	0,09	0,14	0,18	0,21	0,21
475	0,05	0,06	0,07	0,06	0,06	0,07	0,08	0,09	0,11	0,15	0,14
525	0,08	0,10	0,10	0,08	0,10	0,10	0,09	0,13	0,17	0,23	0,21
575	0,05	0,06	0,07	0,05	0,05	0,06	0,09	0,07	0,11	0,14	0,13
625	0,07	0,08	0,09	0,07	0,10	0,11	0,11	0,11	0,15	0,20	0,19
675	0,06	0,08	0,08	0,05	0,08	0,08	0,08	0,07	0,11	0,14	0,14
725	0,04	0,05	0,06	0,05	0,09	0,10	0,10	0,09	0,13	0,18	0,18
775	0,06	0,07	0,07	0,05	0,08	0,07	0,08	0,08	0,11	0,16	0,15
825	0,03	0,03	0,04	0,04	0,07	0,08	0,10	0,08	0,12	0,16	0,17
875	0,05	0,05	0,05	0,06	0,08	0,07	0,08	0,08	0,11	0,15	0,14
925	0,05	0,06	0,06	0,04	0,04	0,06	0,08	0,07	0,10	0,13	0,14
975	0,04	0,04	0,04	0,05	0,06	0,06	0,07	0,07	0,09	0,13	0,12
1025	0,07	0,08	0,08	0,04	0,05	0,07	0,09	0,07	0,09	0,11	0,12
1075	0,05	0,07	0,06	0,05	0,05	0,06	0,08	0,06	0,07	0,10	0,10
1125	0,08	0,09	0,10	0,05	0,06	0,08	0,08	0,07	0,09	0,11	0,12
1175	0,08	0,09	0,09	0,04	0,05	0,06	0,07	0,06	0,07	0,08	0,09
1225	0,07	0,10	0,10	0,06	0,08	0,09	0,08	0,07	0,08	0,10	0,11
1275	0,09	0,11	0,11	0,04	0,06	0,07	0,06	0,06	0,07	0,08	0,09
1325	0,06	0,08	0,08	0,05	0,07	0,09	0,07	0,08	0,08	0,10	0,11
1375	0,10	0,11	0,11	0,05	0,07	0,07	0,06	0,06	0,08	0,08	0,10
1425	0,06	0,07	0,07	0,04	0,05	0,07	0,07	0,09	0,09	0,11	0,12
1475	0,08	0,09	0,09	0,05	0,07	0,08	0,06	0,07	0,09	0,09	0,10
1525	0,08	0,09	0,08	0,04	0,05	0,06	0,06	0,09	0,09	0,11	0,12
1575	0,06	0,06	0,06	0,05	0,06	0,07	0,06	0,08	0,10	0,10	0,11
1625	0,10	0,12	0,11	0,04	0,05	0,06	0,06	0,09	0,09	0,11	0,12
1675	0,06	0,07	0,07	0,04	0,06	0,07	0,07	0,09	0,11	0,11	0,12
1725	0,11	0,14	0,14	0,05	0,06	0,07	0,06	0,08	0,09	0,10	0,11
1775	0,09	0,11	0,11	0,04	0,08	0,09	0,08	0,11	0,12	0,12	0,13
1825	0,10	0,13	0,14	0,05	0,07	0,08	0,07	0,08	0,08	0,10	0,11
1875	0,11	0,14	0,14	0,06	0,09	0,12	0,10	0,11	0,13	0,12	0,14
1925	0,07	0,10	0,11	0,04	0,06	0,06	0,07	0,08	0,08	0,10	0,11
1975	0,12	0,15	0,15	0,07	0,10	0,12	0,10	0,12	0,12	0,12	0,14



Annex to the Certificate of Conformity self-generation unit No. U18-0290

F.3 Requirements for the test report for power generation units

Extract from the test report for unit certification

Nr. ZEK-18JA0679FCSP

„Determination of electrical properties“

Higher frequencies

(tested according to VDE 0124-100 point 5.1.4)

P/P _n [%]	0	10	20	30	40	50	60	70	80	90	100
f [kHz]	I _h [%]										
2,1	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44
2,3	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44
2,5	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44	0,44
2,7	0,44	0,43	0,43	0,43	0,43	0,44	0,43	0,43	0,43	0,43	0,44
2,9	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43
3,1	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43
3,3	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43
3,5	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43	0,43
3,7	0,43	0,43	0,43	0,43	0,43	0,42	0,43	0,43	0,43	0,42	0,43
3,9	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42
4,1	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42
4,3	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42
4,5	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42
4,7	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42	0,42
4,9	0,42	0,42	0,41	0,42	0,41	0,42	0,42	0,41	0,42	0,42	0,42
5,1	0,42	0,42	0,41	0,41	0,42	0,41	0,41	0,41	0,41	0,42	0,42
5,3	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41
5,5	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41
5,7	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41
5,9	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41
6,1	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41
6,3	0,41	0,41	0,41	0,40	0,41	0,41	0,41	0,41	0,41	0,40	0,41
6,5	0,41	0,40	0,41	0,41	0,40	0,40	0,40	0,41	0,40	0,40	0,41
6,7	0,41	0,41	0,40	0,41	0,40	0,40	0,40	0,40	0,40	0,40	0,41
6,9	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41	0,41
7,1	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40
7,3	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40
7,5	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40
7,7	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40
7,9	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40
8,1	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40
8,3	0,40	0,40	0,40	0,40	0,40	0,40	0,39	0,40	0,40	0,40	0,40
8,5	0,40	0,40	0,39	0,40	0,40	0,40	0,40	0,40	0,40	0,40	0,40
8,7	0,39	0,40	0,39	0,39	0,39	0,40	0,39	0,39	0,40	0,40	0,39
8,9	0,40	0,39	0,39	0,40	0,39	0,39	0,39	0,39	0,39	0,40	0,40

Note:

The reference current is 2,39 A.

The harmonic values are average values from the individual phase.